

**CUSTOMER:** Tjoapack  
**LABEL:** BOTTLE LABEL - SCB VSN 24/26mg 60ct  
**DRAWING/ITEM NUMBER:** 70017450-00  
**LABEL MATERIAL:** 54332 PH SG, S727,40  
**JOB:** 49577  
**P.O.:** N/A  
**DATE:** 12.15.2025  
**SCALE** 1:1  
**SHEET** 1 OF 1  
**MODEL BY:** BURKHEAD-DEVANE

**COLORS:**

Unvarnished Area

PMS 300

PMS 513

PMS Black

*Die line is for reference only.*


*Web/Carrier line if for reference only.*

BURKHEAD  
DEVANE

www.burkheaddevane.com

**Pharmaceutical  
Label Specialists**

**\*Return to  
Burkhead DeVane  
407 Cumberland Street  
Fayetteville, NC 28301  
Phone: 800.633.2450  
Fax: 910.483.4754  
www.burkheaddevane.com**

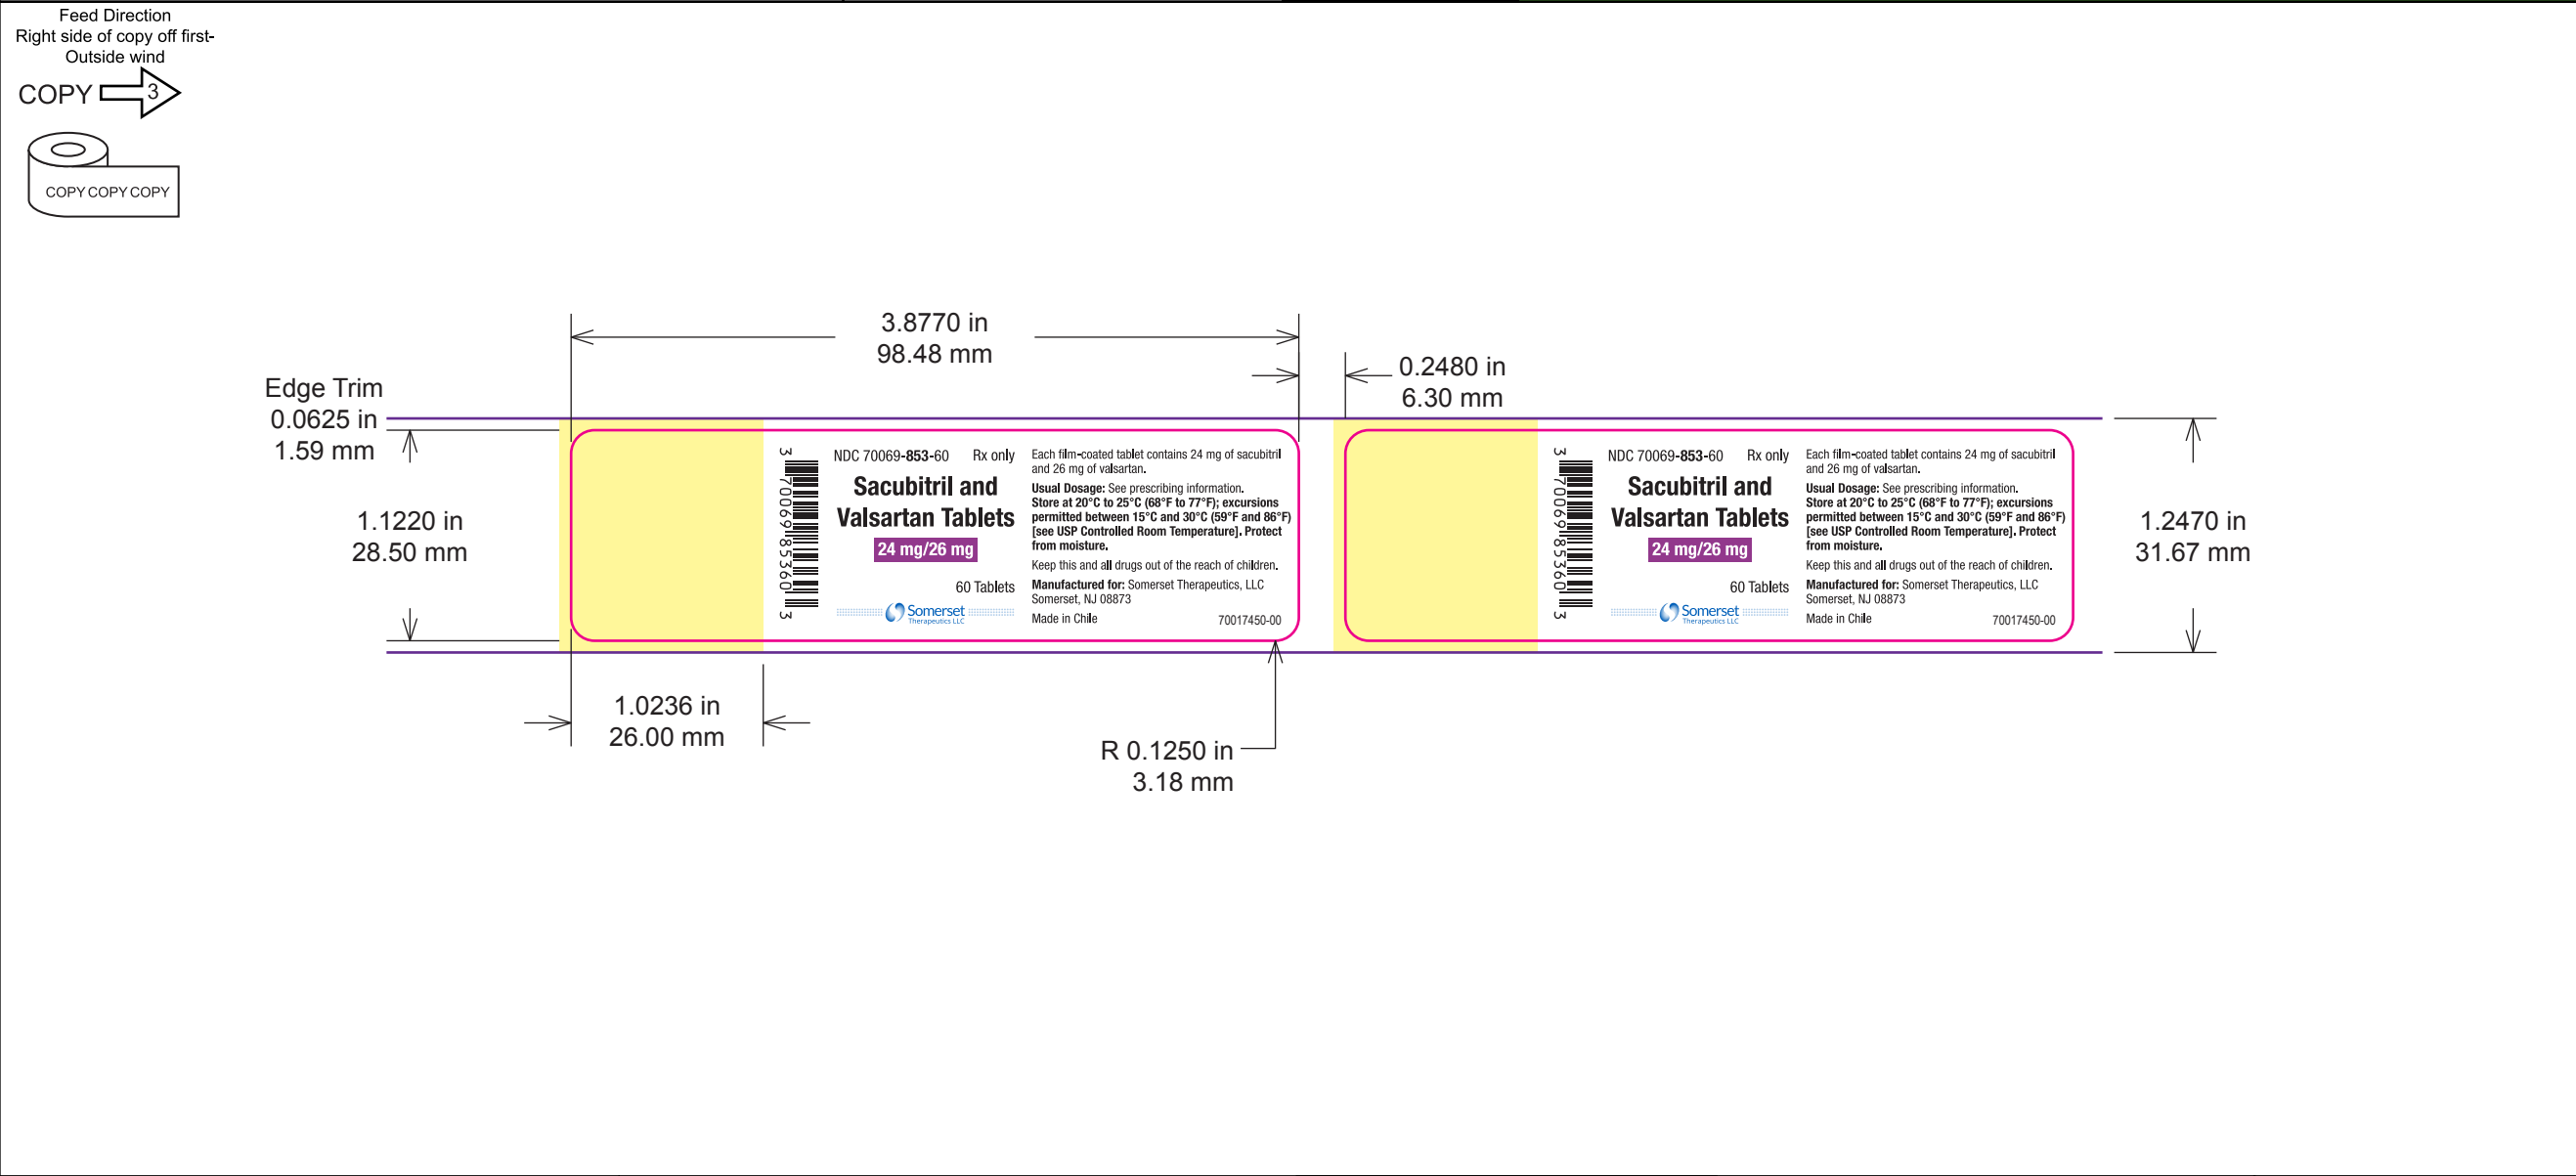

|                                                                                                                                                                                                                                                                                                                                          |                                                                                                                                                                                                                                                                                                                                                                                                          |                                                                                                           |           |      |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------|-----------|------|
| <p>Any printed or saved version of this document is uncontrolled unless printed with the next word "Controlled" in red and issued by the ISO Quality Systems Manager.</p> <p>Burkhead DeVane will provide the first two proofs at no cost. Subsequent proofs will be charged at \$50.00 per revision.</p> <p>FORM# ART 5 R3 12-14-20</p> | <p>PROPRIETARY NOTICE: THIS DOCUMENT AND ALL INFORMATION HEREIN IS THE CONFIDENTIAL PROPERTY OF LIEBEL FLARSHEIM AND SHALL NOT BE COPIED, DISCLOSED TO THIRD PARTIES CONFIDENTIALLY OR NON-CONFIDENTIALLY, PUBLICLY DISCLOSED, OR USED FOR ANY PURPOSE OTHER THAN THE SPECIFIC PURPOSE FOR WHICH IT WAS PROVIDED WITHOUT PRIOR WRITTEN AUTHORIZATION, AND SHALLBE DESTROYED OR RETURNED UPON DEMAND.</p> | <p>*Please review this proof for text accuracy and color placement and initial in the space provided.</p> | APPROVALS | DATE |
|                                                                                                                                                                                                                                                                                                                                          |                                                                                                                                                                                                                                                                                                                                                                                                          |                                                                                                           |           |      |